
## **Energy Management Smart Modular Power Analyzer Type WM30 96**



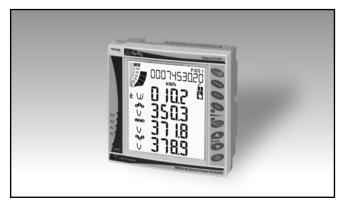

- One RS232 and RS485 port (on request)
- Communication protocol: MODBUS-RTU
- MODBUS TCP/IP Ethernet port (on request)
- BACnet-IP over Ethernet port (on request)
- BACnet MS/TP over RS485, BTL approved (on request)
- Ethernet/IP port, ODVA approved (on request)
- Profibus DP V0 port (on request)
- Up to 2 digital outputs (pulse, alarm, remote control) (on request)
- Up to 4 freely configurable virtual alarms
- Up to 2 analogue outputs (+20mA, +10VDC) (on request)

- · Class 0.5 (kWh) according to EN62053-22
- Class C (kWh) according to EN50470-3
- Class 2 (kvarh) according to EN62053-23
- Accuracy ±0.2% RDG (current/voltage)
- Instantaneous variables readout: 4x4 DGT
- Energies readout: 9+1 DGT
- · System variables: VLL, VLN, A, VA, W, var, PF, Hz, Phase-sequence-asymmetry-loss.
- Single phase variables: VLL, VLN, AL, An (calculated), VA, W, var, PF
- · Both system and single phase variables with average and max calculation
- Harmonic analysis (FFT) up to the 32nd harmonic (current and voltage)
- · Energy measurements (imported/exported): total and partial kWh and kvarh
- Energy measurements according to ANSI C12.20 CA 0.5, ANSI C12.1 (revenue grade)
- Run hours counter (8+2 DGT)
- Real time clock function
- Application adaptable display and programming procedure (Easyprog function)
- Universal power supply: 24-48 VDC/AC, 100-240 VDC/AC
- Front dimensions: 96x96 mm
- Front protection degree: IP65, NEMA4X, NEMA12

### **Product Description**

Three-phase smart recommended for measurement of the with digital outputs that can be WM3040Soft.

power either for pulse proportional to the analyzer with built-in advanced active and reactive energy being configuration system and LCD measured or/and for alarm outputs. data displaying. Particularly The instrument can be equipped the with the following modules: RS485/ main RS232, Ethernet, BACnet-IP, electrical variables. WM30 is BACnet MS/TP or Profibus DP based on a modular housing for V0 communication ports, pulse panel mounting with IP65 (front) and alarm outputs. Parameters protection degree. Moreover, programming and data reading can the analyzer can be provided be easily performed by means of

#### How to order WM30-96 AV5 3 H R2 A2 S1 XX Model Range code \_ System Power Supply \_ A Outputs \_ **B** Outputs Communication \_ Option .

## Type Selection

Range	e codes	Syst	em	Pow	er supply	A Ou	tputs
AV4:	400/690V <sub>LL</sub> AC 1(2)A V <sub>LN</sub> : 160V to 480V <sub>LN</sub>	3:	balanced and unbalanced load: 3-phase, 4-wire;	H:	100-240 +/-10% (90 to 255) VDC/AC (50/60 Hz)	XX: O2:	none Dual channel static output
AV5:	V <sub>LL</sub> : 277V to 830V <sub>LL</sub> 400/690V <sub>LL</sub> AC 5(6)A V <sub>LN</sub> : 160V to 480V <sub>LN</sub>		3-phase, 3-wire; 2-phase, 3-wire; 1-phase, 2-wire	L:	24-48 +/-15% (20 to 55) VDC/AC (50/60 Hz)	R2:	Dual channel relay output
AV6:	V <sub>LL</sub> : 277V to 830V <sub>LL</sub>	Optio	ons	Com	munication	B Ou	itputs
AV7:	5(6)A $V_{LN}$ : 40V to 144 $V_{LN}$ $V_{LL}$ : 70V to 250 $V_{LL}$ 100/208 $V_{LL}$ AC	XX:	none	XX: S1: E2:	none RS485/RS232 port Ethernet / Internet	XX: A2:	none Dual channel 20mA DC output
	1(2)A $V_{LN}$ : 40V to 144 $V_{LN}$ $V_{LL}$ : 70V to 250 $V_{LL}$			B1:	port BACnet (IP) over Ethernet	V2:	Dual channel 10V DC output
	VII. 10V to 250VII			В3:	BACnet (MS/TP) over RS485		
				E6: P1:	Ethernet/IP port Profibus DP/V0 port		




### Position of modules and combination

Ref	Description	Main features	Part number	Pos. A	Pos. B	Pos. C
1		Inputs/system: AV5.3     Power supply: H	WM30 AV5 3 H			
2		Inputs/system: AV6.3     Power supply: H	WM30 AV6 3 H			
3		Inputs/system: AV4.3     Power supply: H	WM30 AV4 3 H			
4	WM30 base provided with display,	Inputs/system: AV7.3     Power supply: H	WM30 AV7 3 H			
	power supply, measuring inputs	Inputs/system: AV5.3     Power supply: L	WM30 AV5 3 L			
		Inputs/system: AV6.3     Power supply: L	WM30 AV6 3 L			
		Inputs/system: AV4.3     Power supply: L	WM30 AV4 3 L			
		Inputs/system: AV7.3     Power supply: L	WM30 AV7 3 L			
5	Dual relay output (SPDT)	2-channel     Alarm or/and pulse output	M O R2	Х		
6	Dual static output (AC/DC Opto-Mos)	2-channel     Alarm or/and pulse output	M O O2	X		
7	Dual analogue output (+20mADC)	• 2-channel	M O A2		X	
8	Dual analogue output (+10VDC)	• 2-channel	M O V2		Х	
9	RS485 / RS232 port module	• Max. 115.2 Kbps	M C 485 232			Х
10	Ethernet port module	• RJ45 10/100 BaseT	M C ETH			X
11	BACnet-IP port module	Based on Ethernet bus	M C BAC IP			Х
12	BACnet-MS/TP port module	Over RS485	M C BAC MS			х
13	Ethernet/IP	Based on Ethernet	MCEI			Х
14	Profibus module	Profibus DP V0     Over RS485	МСРВ			Х

#### NOTE:

The position of the modules shall respect the sequence A-B-C. Possible arrangements are M, M-A, M-B, M-C, M-A-B, M-A-C, M-B-C and M-A-B-C where "M" is the basic module.

It is possible to use the WM30-96 without any additional module as a simple indicator.





## Input specifications

Rated inputs	System type: 1, 2 or 3-phase	Energy additional errors	According to EN62053-22, ANSI C12.20,
Input type	Galvanic insulation by means of built-in CT's	Influence quantities	Class B or C according to EN50470-3, EN62053-23,
Current range (by CT)	AV5 and AV6: 5(6)A AV4 and AV7: 1(2)A	Total Harmonic Distortion (THD)	ANSI C12.1 ±1% FS (FS: 100%)
Voltage (by direct connection or VT/PT)	AV4, AV5: 400/690VLL; AV6, AV7: 100/208VLL	()	AV4: Imin: 5mARMS; Imax: 3A; Umin: 30VRMS; Umax: 679Vp AV5: Imin: 5mARMS; Imax:
Accuracy (Display + RS485) (@25°C ±5°C,			15Ap; Umin: 30VRMS; Umax: 679Vp
R.H. ≤60%, 48 to 62 Hz)	In: see below, Un: see below		AV6: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS;
AV4 model	In: 1A, Imax: 2A; Un: 160 to 480VLN (277 to 830VLL)		Umax: 204Vp AV7: Imin: 5mARMS; Imax:
AV5 model	In: 5A, Imax: 6A; Un: 160 to 480VLN (277 to 830VLL)		3A; Umin: 30VRMS; Umax: 204Vp
AV6 model	In: 5A, Imax: 6A; Un:	Temperature drift	≤200ppm/°C
	40 to 144VLN (70 to 250VLL)	Sampling rate	3200 samples/s @ 50Hz,
AV7 model	In: 1A, Ímax: 2A; Un: 40 to	Measurements	3840 samples/s @ 60Hz See "List of the variables
Current AV4, AV5, AV6, AV7	144VLN (70 to 250VLL)	WiedSurements	that can be connected to:"
models	From 0.01In to 0.05In: ±(0.5% RDG +2DGT)	Method	TRMS measurements of distorted wave forms.
	From 0.05In to Imax:	Coupling type	By means of CT's
Phase-neutral voltage	±(0.2% RDG +2DGT) In the range Un: ±(0,2%	Crest factor	AV5, AV6: ≤3 (15A max.
· ·	RDG +1DGT)		peak) AV4, AV7: ≤3 (3A max.
Phase-phase voltage	In the range Un: ±(0.5% RDG +1DGT)		peak)
Frequency	±0.01Hz (45 to 65Hz)	Current Overloads Continuous (AV5 and AV6)	6A, @ 50Hz
Active and Apparent power	From 0.01In to 0.05In, PF 1: ±(1%RDG+1DGT)	Continuous (AV4 and AV7)	2A, @ 50Hz
	From 0.05In to Imax	For 500ms (AV5 and AV6) For 500ms (AV4 and AV7)	120A, @ 50Hz 40A, @ 50Hz
	PF 0.5L, PF1, PF0.8C: ±(0.5%RDG+1DGT)	Voltage Overloads	
Power Factor	±[0.001+0.5% (1.000 - "PF RDG")]	Continuous For 500ms	1.2 Un 2 Un
Reactive power	From 0.02In to	Input impedance	
	0.05ln, senφ 1: ±(1.5%RDG+1DGT)	400VL-L (AV4 and AV5) 208VL-L (AV6 and AV7)	> 1.6MΩ > 1.6MΩ
	From 0.05In to Imax, seno	5(6)A (AV5 and AV6)	< 0.2VA
	1: ±(1%RDG+1DGT)	1(2)A (AV4 and AV7)	< 0.2VA
	From 0.05In to 0.1In, senφ 0.5L/C:	Frequency	40 to 440 Hz
	±(1.5%RDG+1DGT) From 0.1In to Imax, senφ		
	0.5L/C: ±(1%RDG+1DGT)		
Active energy	Class 0.5 according to EN62053-22, ANSI C12.20 Class C according to		
Reactive energy	EN50470-3. Class 2 according to EN62053-23, ANSI C12.1.		
Start up current AV5, AV6 Start up current AV4, AV7	5mA 1mA		
a. ap 3a. 3n. / 1, / 1, / 17			
		'	

## CARLO GAVAZZI

## **Output specifications**

Relay outputs (M O R2)	0/ 4	Pulse type	Programmable from 0.001
Physical outputs	2 (max. 1 module per instrument)		to 10.00 kWh/kvarh per
Purpose	For either alarm output or		pulse.The above listed variables can be connected
<del>-</del>	pulse output		to any output.
Туре	Relay, SPDT type AC 1-5A @ 250VAC; AC	Pulse duration	≥100ms < 120msec (ON),
	15-1.5A @ 250VAC		≥120ms (OFF), according to EN62052-31
Configuration	By means of the front key-	Remote controlled outputs	The activation of the
Function	pad The outputs can work as		outputs is managed
Tanodon	alarm outputs but also		through the serial communication port
	as pulse outputs, remote	Insulation	See "Insulation between
	controlled outputs, or in any other combination.	-	inputs and outputs" table
Alarms	Up alarm and down alarm	20mA analogue outputs (M O A2)	
	linked to the virtual alarms,	Number of outputs	2 per module (max. 1
	other details see Virtual alarms	·	module per instrument)
Min. response time	≤200ms, filters excluded.	Accuracy (@ 25°C ±5°C, R.H. ≤60%)	±0.2%FS
Dulas	Set-point on-time delay: "0 s".	(@ 23 C ±3 C, K.H. <u>≥</u> 00 //) Range	0 to 20mA
Pulse Signal retransmission	Total: +kWh, -kWh, +kvarh,	Configuration	By means of the front key-
<b>9</b>	-kvarh.	Signal retransmission	pad The signal output can
	Partial: +kWh, -kWh,	Olgrial Tetransmission	be connected to any
Pulse type	+kvarh, -kvarh. Programmable from 0.001		instantaneous variable
,,,,	to 10.00 kWh/kvarh per		available in the table "List of the variables that can be
	pulse. The above listed variables can be connected		connected to".
	to any output.	Scaling factor	Programmable within
Pulse duration	≥100ms <120msec (ON),		the whole range of retransmission.
	≥120ms (OFF), according to EN62052-31	Response time	≤400 ms typical (filter
Remote controlled	10 EN02032-31	Diameter	excluded)
outputs	The activation of the	Ripple	≤1% (according to IEC 60688-1, EN 60688-1)
	outputs is managed through the serial	Total temperature drift	≤500 ppm/°C
	communication port	Load	≤600Ω
Insulation	See "Insulation between	Insulation	See "Insulation between inputs and outputs" table
Static outputs (M.O.O2)	inputs and outputs" table	10VDC analogue outputs	
Static outputs (M O O2) Physical outputs	Opto-Mos type 2 (max. 1 module per	(M O V2)	
·	instrument)	Number of outputs	2 (max. 1 module per instrument)
Purpose	For either pulse output or alarm output	Accuracy	modulity)
Signal	V <sub>on</sub> : 2.5VAC/DC/max.100mA	(@ 25°C ±5°C, R.H. ≤60%)	±0.2%FS
-	V <sub>OFF</sub> : 42VDC max.	Range Configuration	0 to 10 VDC By means of the front key-
Configuration	By means of the front key- pad	•	pad
Function	The outputs can work as	Signal retransmission	The signal output can
	alarm outputs but also		be connected to any instantaneous variable
	as pulse outputs, remote controlled outputs, or in		available in the table "List
	any other combination.		of the variables that can be connected to".
Alarms	Up alarm and down alarm linked to the virtual alarms,	Scaling factor	Programmable within
	other details see Virtual	•	the whole range of
	alarms	Response time	retransmission; ≤400 ms typical (filter
Min. response time	≤200ms, filters excluded. Set-point on-time delay: "0	. 135651135 11110	excluded)
	s".	Ripple	≤1% (according to IEC
Pulse	T ( 1 -1380 -1380 -1	Total temperature drift	60688, EN 60688) ≤350 ppm/°C
Signal retransmission	Total: +kWh, -kWh, +kvarh, -kvarh.	Load	≥10kΩ
	Partial: +kWh, -kWh,	Insulation	See "Insulation between inputs and outputs" table
	+kvarh, -kvarh.		inputs and outputs" table



## Output specifications (cont.)

RS485	(on	request)	
-------	-----	----------	--

Type

Connections

Addresses

Protocol

Data (bidirectional) Dynamic (reading only)

Static (reading and writing only)

Data format

Baud-rate

Driver input capability

Note

Insulation

RS232 port (on request)

Type

Connections Protocol

Data (bidirectional) Dynamic (reading only)

Static (reading and writing only)

Data format

Baud-rate

Note

Insulation

Multidrop, bidirectional (static and dynamic

variables) 2-wire

Max. distance 1000m, termination directly on the

module

247, selectable by means of the front key-pad MODBUS/JBUS (RTU)

System and phase variables: see table "List of variables..

All the configuration

parameters. 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s 1/5 unit load. Maximum

160 transceivers on the same bus.

With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this

case just the data reading is allowed. See "Insulation between

inputs and outputs" table

Bidirectional (static and dynamic variables) 3 wires. Max. distance 15m MODBUS RTU /JBUS

System and phase variables: see table "List of

variables.. All the configuration

parameters

1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not

allowed anymore. In this case just the data reading is allowed.

See "Insulation between inputs and outputs" table Ethernet/Internet port (on request)

**Protocols** IP configuration

Client connections Connections

Data (bidirectional) Dynamic (reading only)

(reading and writing only)

Note

Modbus TCP/IP Static IP / Netmask / Default gateway Selectable (default 502)

Max 5 simultaneously RJ45 10/100 BaseTX Max. distance 100m

System and phase variables: see table "List of

variables...

All the configuration parameters.

With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading

is allowed. See "Insulation between inputs and outputs" table

**BACnet-IP** (on request)

Insulation

Protocols

**BACnet-IP** 

IP configuration

Device object instance

Supported services

Supported objects

IP configuration

Modbus TCP/IP

Client connections

Connections

BACnet-IP (for measurement reading purpose and to write object description) and Modbus TCP/IP (for measurement reading purpose and for programming parameter purpose)

Static IP / Netmask / Default gateway Fixed: BAC0h

0 to 9999 selectable by key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet.

"I have", "I am", "Who has", "Who is", "Read (multiple) Property"

Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8

(device)

Static IP / Netmask / Default gateway

See "Ethernet/Internet port" above

Modbus only: max 5 simultaneously RJ45 10/100 BaseTX Max.

distance 100m



### Output specifications (cont.)

Data RJ45 10/100 BaseTX Max. Connections Dynamic (reading only) System and phase distance 100m variables (BACnet-IP and Data Modbus): see table "List of Dynamic (reading only) System and phase variables' variables: see table "List of Static variables... All the configuration parameters (Modbus only) (reading and writing only) Note With the rotary switch (reading and writing only) (on the back of the basic unit) in lock position Note the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading is allowed. Insulation See "Insulation between inputs and outputs" table is allowed. Insulation **BACnet MS/TP (on request)** Available ports 2: RS485 and Ethernet RS485 port Approval **BTL** Type Multidrop, mono-directional Ethernet/IP (on request) (dynamic variables) Ethernet/IP (for **Protocols** Connections 2-wire Max. distance measurement reading 1000m, termination directly purpose) and Modbus TCP/IP (for programming on the module 0 to 9999 selectable by Device object instance parameter purpose) Static IP / Netmask / Default gateway key-pad IP configuration 0 to 2^22-2 = 4.194.302, selectable by programming Modbus Port Selectable (default 502) software or by BACnet. Modbus only: max 5 simultaneously RJ45 Protocol BACnet MS/TP (for measurement reading 10/100 Base TX purpose and to write object Max distance 100m description) Ethernet/IP port "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Supported services Topology Star Type 2 (analogue value, Supported objects I evel including COV property), Connection Type 5 (binary-value for target up to 16 virtual alarm Messaging re-transmission) Type 8 (device) Supported features Data (mono-directional) Detection) Dynamic System and phase **UCMM** 

Static Data format

Baud-rate

Driver input capability

MAC addresses Ethernet port Protocol

IP configuration

Modbus Port Client connections variables: see table "List of variables.. Not available 1 start bit, 8 data bit, no parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k or 76.8k kbit/s 1/5 unit load. Maximum 160 transceivers on the same bus.

Modbus TCP/IP (for programming parameter purpose) Static IP / Netmask / Default gateway Selectable (default 502) Modbus only: max 5

All the configuration parameters (Modbus only). With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading

See "Insulation between inputs and outputs" table

Selectable: 0 to 127

simultaneously

RJ45 standard Max distance 100m

Commercial level Connection establishment: Class 1 and class 3

messanging ACD (Address Conflict

List service 0x0004 List identity 0x0063 Register session 0x0065 Unregister session 0x0066 Send RR data 0x006F

Dynamic (reading only)

Static (reading and writing only)

Insulation Approval

System and phase variables (Ethernet/IP): see Ethernet/IP protocol document

Send Unit Data 0x0070

All the configuration

parameters (Modbus TCP only) See "Insulation between inputs and outputs" table Ethernet IP conformance tested (ODVA)



## **Output specifications (cont.)**

## **Energy meters**

Meters Total Partial Pulse output	4 (9+1 digit) 4 (9+1 digit)  Connectable to total and/or		Min9,999,999,999 kWh/ kvarh Max. 9,999,999,999 kWh/ kvarh.
Energy meter recording	partial meters  Storage of total and partial energy meters.  Energy meter storage format (EEPROM)	Type Total energy meters Partial energy meters	+kWh, +kvarh, -kWh, -kvarh +kWh, +kvarh, -kWh, -kvarh

## Harmonic distortion analysis

Analysis principle	FFT		The same for the other
Harmonic measurement			phases: L2, L3.
Current Voltage	Up to the 32nd harmonic Up to the 32nd harmonic	System	The harmonic distortion can be measured in 3-wire
Type of harmonics	THD (VL1 and VL1-N) The same for the other phases: L2, L3. THD (AL1)		or 4-wire systems. Tw: 0.02 sec@50Hz without filter



# Display, LED's and commands

Display refresh time	≤ 250 ms	Consultation of the consul	Dod LED (amb. MA/b)
Display	4 lines, 4-DGT, 1 lines, 10-DGT	Energy consumption kWh pulsating	Red LED (only kWh) 0.001 kWh/kvarh by pulse if the Ct ratio by VT ratio is
Туре	LCD, single colour backlight		≤7 0.01 kWh/kvarh by pulse if
Digit dimensions	4-DGT: h 9.5mm; 10-DGT: h 6.0mm		the Ct ratio by VT ratio is ≥7.1 ≤70.0
Instantaneous variables read-out Energies variables read-out	4-DGT Imported Total/Partial: 8+2DGT, 9+1DGT or 10DGT; Exported Total/Partial: 8+2DGT, 9+1DGT or 10DGT (with "-" sign).		0.1 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥70.1 ≤700.0 1 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥700.1 ≤7000 10 kWh/kvarh by pulse if
Run Hours counter	8+2 DGT (99.999.999 hours and 59 minutes max)		the Ct ratio by VT ratio is ≥7001 ≤70.00k
Overload status	EEEE indication when the value being measured is exceeding the "Continuous inputs overload" (maximum measurement capacity)		100 kWh/kvarh by pulse if the Ct ratio by VT ratio is >70.01k Max frequency: 16Hz, according to EN50470-1
Max. and Min. indication	Max. instantaneous variables: 9999; energies: 9 999 999 999. Min. instantaneous variables: 0.000; energies 0.0	Back position LEDs On the base On the communication modules	Green as power-on Two LEDs: one for TX (green) and one for RX (amber).
Front position LEDs		Key-pad	For variable selection,
Virtual alarms	4 red LED available in case of virtual alarm (AL1-AL2-AL3-AL4). Note: the real alarm is just the activation of the proper static or relay output if the proper module is available.		programming of the instrument working parameters, "dmd", "max", total energy and partial energy Reset

## **Main functions**

Password  1st level  2nd level	Numeric code of max. 4 digits; 2 protection levels of the programming data: Password "0", no protection; Password from 1 to 9999,	System 3-Ph.2 balanced load  System 2-Ph System 1-Ph	3-phase (2-wire), one current and 1-phase (L1) to neutral voltage measurement. 2-phase (3-wire) 1-phase (2-wire)
System selection System 3-Ph.n unbalanced load System 3-Ph. unbalanced load	3-phase (4-wire) 3-phase (3-wire), three currents and 3-phase to phase voltage measurements, or in case of Aaron connection two currents (with special	Transformer ratio VT (PT) CT	1.0 to 999.9 / 1000 to 9999. 1.0 to 999.9 / 1000 to 9999 (up to 10kA in case of CT with 1A secondary current and up to 50kA in case of CT with 5A secondary current).
System 3-Ph.1 balanced load	wiring on screw terminals) and 3-phase to phase voltage measurements. 3-phase (3-wire), one current and 3-phase to phase voltage measurements 3-phase (4-wire), one current and 3-phase to neutral voltage measurements.	Filter Operating range Filtering coefficient Filter action	Selectable from 0 to 100% of the input display scale Selectable from 1 to 32 Measurements, analogue signal retransmission, serial communication (fundamental variables: V, A, W and their derived ones).



## Main functions (cont.)

<b>Displaying</b> Number of variables	Up to 5 variables per page. See "Front view". 7 different set of variables available (see "Display pages") according to the application being selected. One page is	Harmonic analysis	values total energies: kWh, kvarh; - partial energies: kWh, kvarh  Up to the 32 <sup>nd</sup> harmonics on current and voltage
Backlight The backlight	freely programmable as combination of variables. time is programmable from 0 (always on) to 255 minutes	Functions Time format	Universal clock and calendar. Hour: minutes: seconds with selectable 24 hours or
Virtual alarms Working condition	In case of basic unit or with the addition of M O R2 or M O O2 digital output	Date format  Battery life	12H AM/PM format. Day-month-year with selectable DD-MM-YY or MM-DD-YY format. 10 years
No. of alarms Working mode Controlled variables  Set-point adjustment	modules. Up to 4 Up alarm and down alarm. The alarms can be connected to any instantaneous variable available in the table "List of the variables that can be connected to". From 0 to 100% of the	Easy programming function	For all the display selections, both energy and power measurements are independent from the current direction. The displayed energy is always "imported" with the only exception of "C", "D", "E" and "G" types (see
Hysteresis	display scale From 0 to 100% of the display scale		"display pages" table). For those latter selections the energies can be either
On-time delay Min. response time	0 to 255s ≤ 200ms, filters excluded. Set-point on-time delay: "0 s".		"imported" or "exported" depending on the current direction.
Reset	By means of the front key- pad. It is possible to reset the following data: - all the max and dmd		

# **General specifications**

Operating temperature	-25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053-23	EMC Electrostatic discharges Immunity to irradiated electromagnetic fields	According to EN62052-11 15kV air discharge  Test with current: 10V/m from 80 to 2000MHz Test without any current:
Storage temperature	-30°C to +70°C (-22°F to 158°F) (R.H. < 90% non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053- 23	Burst Immunity to conducted disturbances	30V/m from 80 to 2000MHz On current and voltage measuring inputs circuit: 4kV  10V/m from 150KHz to
Installation category	Cat. III (IEC60664, EN60664)	Surge	80MHz On current and voltage
Insulation (for 1 minute)	See "Insulation between inputs and outputs" table		measuring inputs circuit: 4kV; on "L" auxiliary power supply input: 1kV
Dielectric strength	4kVAC RMS for 1 minute	Radio frequency suppression	According to CISPR 22
Noise rejection CMRR	100 dB, 48 to 62 Hz		-



## **General specifications (cont.)**

Standard compliance Safety	IEC60664, IEC61010-1 EN60664, EN61010-1 EN62052-11.	Housing DIN Dimensions (WxHxD)	Module holder: 96x96x50mm. "A" and "B" type modules:
Metrology Pulse output	EN62053-21. EN62053-22, EN62053-23, EN50470-3. DIN43864, IEC62053-31		89.5x63x16mm. "C" type module: 89.5x63x20mm.
Approvals	Eligible System performance Meter for Go Solar California, CE, cULus "Listed"	Max. depth behind the panel  Material	With 3 modules (A+B+C): 81.7 mm ABS/Nylon PA66, self- extinguishing: UL 94 V-0
Connections Cable cross-section area	Screw-type max. 2.5 mm². min./max. screws tightening torque: 0.4 Nm / 0.8 Nm. Suggested screws tightening torque: 0.5 Nm	Mounting  Protection degree Front Screw terminals  Weight	Panel mounting  IP65, NEMA4x, NEMA12 IP20  Approx. 420 g (packing included)

## Insulation between inputs and outputs

	Power Supply (H o L)	Mesuring inputs	Relè output (MOR2)	Static ouput (MOO2)	Serial port	Ethernet port	Analogue outputs
Power Supply (H o L)	-	4kV	4kV	4kV	4kV	4kV	4kV
Mesuring inputs	4kV	-	4kV	4kV	4kV	4kV	4kV
Relè output (MOR2)	4kV	4kV	2kV	-	4kV	4kV	4kV
Static ouput (MOO2)	4kV	4kV	-	2kV	4kV	4kV	4kV
Serial port	4kV	4kV	4kV	4kV	-	-	4kV
Ethernet port	4kV	4kV	4kV	4kV	-	-	4kV
Analogue outputs	4kV	4kV	4kV	4kV	4kV	4kV	4kV <sup>(1)</sup>

<sup>(1):</sup> respect another module 4kV, in the same module 0kV.

**NOTE:** all the models have, mandatory, to be connected to external current transformers because the isolation among the current inputs is just functional (100VAC).

<sup>-:</sup> combination not allowed.



### List of the variables that can be connected to:

Communication port (all listed variables)
Analogue outputs (all variables with the only exclusion of "energies" and "run hour counter"
Pulse outputs (only "energies")
Alarm outputs ("energies", "hour counter" and "max" excluded)

No	Variable	1-ph.	-	3-ph. 3/4-wire		3-ph. 3-wire	3-ph. 4-wire	Notes
1	VL-N sys	sys O	sys		balanced sys X	unbal. sys #	unbal. sys	sys= system= ∑
2	VL-N Sys VL1	X	X	X	X	# #	X	sys- system- Z
		0	X	X		#	X	
3 4	VL2	0	X	X	X	#	X	
	VL3							
5	VL-L sys	0	#	X	X	X	X	sys= system= ∑
6	VL1-2	#	Х	X	X	X	Х	
7	VL2-3	#	0	Х	X	X	X	
8	VL3-1	#	0	X	X	X	Х	
9	Asys	0	Х	0	0	X	X	
_10	An	#	Х	0	0	0	Х	
_11	AL1	Х	Х	X	X	Х	Х	
_12	AL2	0	Х	X	Х	Х	Х	
13	AL3	0	0	X	Х	X	X	
14	VA sys	Χ	Х	X	Х	X	X	sys= system= ∑
15	VA L1	Χ	X	X	X	#	X	
16	VA L2	0	Х	X	X	#	Х	
17	VA L3	0	0	X	X	#	Х	
18	var sys	Х	Х	Х	Х	Х	Х	sys= system= ∑
19	var L1	Χ	Х	Х	Х	#	Х	
20	var L2	0	Х	Х	Х	#	Х	
21	var L3	0	0	Х	Х	#	Х	
22	W sys	Х	Х	Х	Х	X	Х	sys= system= ∑
23	WL1	X	X	X	X	#	X	
24	WL2	0	X	X	X	#	X	
25	WL3	0	Ô	X	X	#	X	
26	PF sys	X	X	X	X	X	X	sys= system= ∑
27	PF L1	X	X	X	X	#	X	eye eyetem <u>z</u>
28	PF L2	0	X	X	X	#	X	
29	PF L3	0	Ô	X	X	#	X	
30	Hz	X	X	X	X	X	X	
31	Phase seq.	0	X	X	X	X	X	
32	Asy VLL	0	ô	X	X	X	X	Asymmetry
33	Asy VLN	0	X	#	Ô	#	X	Asymmetry
34		X		* X	X			Asymmetry
35	Run Hours		X	X		X	X	Tatal
	kWh (+)	X	X	X	X	X		Total
36	kvarh (+)	X	X	X	X	X	X	Total
37	kWh (+)	X						Partial
38	kvarh (+)	X	Х	X	X	X	Х	Partial
39	kWh (-)	X	Х	X	X	X	X	Total
40	kvarh (-)	X	Х	X	X	X	X	Total
41	kWh (-)	Х	X	X	X	X	Х	Partial
42	kvarh (-)	Х	Х	Х	X	X	Х	Partial
43	A L1 THD	Χ	Х	Х	Х	Х	Х	
44	A L2 THD	0	Х	X	X	X	X	
45	A L3 THD	0	0	X	X	X	X	
46	V L1 THD	Х	Х	X	X	0	X	
47	V L2 THD	0	Х	X	X	0	X	
48	V L3 THD	0	0	X	X	0	X	
49	V L1-2 THD	Х	Х	Х	Х	Х	Х	
50	V L2-3 THD	0	Х	Х	Х	X	Х	
51	V L3-1 THD	0	0	X	X	X	X	

(X) = available; (O) = not available (variable not available on the display); (#) Not available (the relevant page is not displayed)



## **Power supply specifications**

Auxiliary power supply

H: 100-240 +/-10% (90 to 255) VDC/AC (50/60 Hz); L: 24-48 +/-15% (20 to 55) VDC/AC (50/60 Hz)

Power consumption

AC: 20 VA; DC: 10 W

## List of selectable applications

	Description	Notes
Α	Cost allocation	Imported energy metering
В	Cost control	Imported and partial energy metering
С	Complex cost allocation	Imported/exported energy (total and partial)
D	Solar	Imported and exported energy metering with some basic power analyzer function
E	Complex cost and power analysis	Imported/exported energy (total and partial) and power analysis
F	Cost and power quality analysis	Imported energy and power quality analysis
G	Advanced energy and power analysis for power generation	Complete energy metering and power quality analysis

## **Display pages**

Var	No	Line 1	Line 2	Line 3			Note	Applications							
Type	NO	Variable Type	Variable Type	Variable Type	Variable Type	Variable Type	Note	Α	В	С	D	Е	F	G	
	0	Home page		Prograr	mmable			х	х	х	х	х	х	х	
а	1	Total kWh (+)	b, c, d	b, c, d	b, c, d	b, c, d		х	х	х	х	х	х	х	
а	2	Total kvarh (+)	b, c, d	b, c, d	b, c, d	b, c, d		х	Х	Х	Х	Х	х	х	
а	3	Total kWh (-)	b, c, d	b, c, d	b, c, d	b, c, d				Х	Х	Х		х	
а	4	Total kvarh (-)	b, c, d	b, c, d	b, c, d	b, c, d				Х	Х	Х		х	
а	5	kWh (+) partial	b, c, d	b, c, d	b, c, d	b, c, d			Х	Х		Х	х	х	
а	6	kvarh (+) part.	b, c, d	b, c, d	b, c, d	b, c, d			Х	Х		Х	х	х	
а	7	kWh (-) partial	b, c, d	b, c, d	b, c, d	b, c, d				Х		Х		х	
a	8	kvarh (-) part.	b, c, d	b, c, d	b, c, d	b, c, d				Х		х		х	
а	9	Run Hours (99999999.99)	b, c, d	b, c, d	b, c, d	b, c, d				х	х	х	х	х	
b	10	a/Phase seq.	VLN ∑	VL1	VL2	VL3	(1) (2)				Х	Х	х	х	
b	11	a/Phase seq.	VLN ∑	VL1-2	VL2-3	VL3-1	(1) (2)				х	Х	х	х	
b	12	a/Phase seq.	An	AL1	AL2	AL3	(1) (2)				Х	Х	х	х	
b	13	a/Phase seq.	Hz	"ASY"	VLL sys (% asy)	VLL sys (% asy)	(1) (2)				х	х	х	х	
b	14	a/Phase seq.	ΑΣ	AL1	AL2	AL3	(1) (2)				х	х	х	х	
С	15	a/Phase seq.	WΣ	WL1	WL2	WL3	(1) (2)				Х	Х	х	х	
С	16	a/Phase seq.	var ∑	var L1	var L2	var L3	(1) (2)					Х	х	х	
С	17	a/Phase seq.	PF ∑	PF L1	PF L2	PF L3	(1) (2)					Х	х	х	
С	18	a/Phase seq.	VA Σ	VA L1	VA L2	VA L3	(1) (2)					Х	х	х	
d	19	a/Phase seq.		THD V1	THD V2	THD V3	(1) (2)						х	х	
d	20	a/Phase seq.		THD V12	THD V23	THD V31	(1) (2)						х	х	
d	21	a/Phase seq.		THD A1	THD A2	THD A3	(1) (2)						х	х	

Note: the table refers to system 3P.n.

- (1) Also maximum value storage (no EEPROM storage).
- (2) Also average (dmd) value (no EEPROM storage).



## Additional available information on the display

NI-	Line 4	Lina O	Line 0	I in a 4	Lines	N-4-		Applications					
No	Line 1	Line 2	Line 3	Line 4	Line 5	Note	Α	В	С	D	Е	F	G
1	Lot n. (text) xxxx	Yr. (text) xx	SYS (text)	x (1/2/3)	160 (min) "dmd"		х	х	х	х	Х	х	х
2	Conn. xxx.x (3ph.n/3ph/3ph./ 3ph.2/1ph/2ph)	CT.rA (text)	1.0 99.99k	PT.rA (text)	1.09999		x	x	x	x	x	x	х
3	LED PULSE (text) kWh	xxxx kWh per pulse					х	х	х	х	х	х	х
4	PULSE out1 (text) kWh/kvarh	xxxx kWh/kvarh per pulse	+/- tot/PAr				x	x	x	x	x	x	х
5	PULSE out2 (text) kWh/kvarh	xxxx kWh/kvarh per pulse	+/- tot/PAr				х	х	х	х	х	х	х
6	Remote out	out1 (text)	on/oFF	Out2 (text)	on/oFF		Х	Х	х	х	Х	х	х
7	Alarm 1 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					х	х	х	х
8	Alarm 2 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					х	х	х	х
9	Alarm 3 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					х	х	х	х
10	Alarm 4 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					х	х	х	х
11	Analogue 1	Hi:E	0.0 9999	Hi.A	0.0 100.0%					х	Х	х	х
12	Analogue 2	Hi:E	0.0 9999	Hi.A	0.0 100.0%					х	Х	х	х
13	COM port	None / out 1 / out 2	xxx (address)	bdr (text)	9.6/19.2/ 38.4/115.2		х	х	х	х	х	х	х
14	IP address	XXX	XXX	XXX	XXX		х	х	х	Х	Х	Х	Х


## **Back protection rotary switch**

	Function	Rotary switch position	Description
	Unlok	1	All programming parameters are freely modifiable by means of the front key-pad and by means of the communication port.
7	Lock	7	The key-pad, as far as programming is concerned and the data through the serial communication cannot be changed (no writing into meter allowed). Data reading is allowed.




## Accuracy (According to EN50470-3 and EN62053-23)

kWh, accuracy (RDG) depending on the current

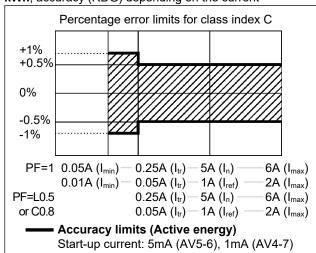

kvarh, accuracy (RDG) depending on the current

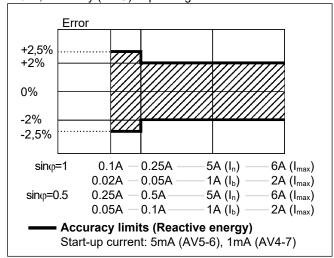

## WM3040Soft parameter progr. and var. reading software

WM3040Soft

Multi-language software (Italian, English, French, German, Spanish) for variable reading, instrument calibration and parameters programming.The program runs under Windows XP/ Vista/7

Working mode

modes can be selected: - management of local RS232 (MODBUS); - management of a local RS485 network (MODBUS);

- managed via TCP port

Three different working

## **Used calculation formulas**

#### Phase variables

Instantaneous effective voltage

$$V_{1N} = \sqrt{\frac{1}{n} \cdot \sum_{1}^{n} (V_{1N})_{i}^{2}}$$

Instantaneous active power

$$W_1 = \frac{1}{n} \cdot \sum_{i=1}^{n} (V_{1N})_i \cdot (A_1)_i$$

Instantaneous power factor

$$\cos \varphi_1 = \frac{W_1}{VA_1}$$

Instantaneous effective current

$$A_1 = \sqrt{\frac{1}{n} \cdot \sum_{i=1}^{n} (A_1)_i^2}$$

Instantaneous apparent power

$$V\!A_1 = V_{1N} \cdot A_1$$

Instantaneous reactive power

$$var_1 = \sqrt{(VA_1)^2 - (W_1)^2}$$

#### System variables

Equivalent three-phase voltage  $V_{\Sigma} = \frac{V_1 + V_2 + V_3}{3} \cdot \sqrt{3}$ 

$$V_{\Sigma} = \frac{V_1 + V_2 + V_3}{3} \cdot \sqrt{3}$$

$$ASY_{LL} = \frac{(V_{LL \text{ max}} - V_{LL \text{ min}})}{V_{LL} \sum_{L} \sum_{L} V_{LL}}$$

Voltage asymmetry 
$$ASY_{LL} = \frac{(V_{LL \max} - V_{LL \min})}{V_{LL} \sum}$$
 
$$ASY_{LN} = \frac{(V_{LN \max} - V_{LN \min})}{V_{LN} \sum}$$
 Three-phase reactive power

$$var_{\Sigma} = (var_1 + var_2 + var_3)$$

Three-phase active power

$$W_{\Sigma} = W_1 + W_2 + W_3$$

Three-phase apparent power

$$VA_{\Sigma} = \sqrt{W_{\Sigma}^2 + \text{var}_{\Sigma}^2}$$

Total harmonic distortion

$$THD_N = 100 \frac{\sqrt{\sum_{n=2}^{N} |X_n|^2}}{|X_1|}$$

Three-phase power factor

$$\cos \varphi_{\Sigma} = \frac{W_{\Sigma}}{VA_{\Sigma}} \tag{TPF}$$

#### **Energy metering**

$$k \operatorname{var} hi = \int_{t_1}^{t_2} Qi(t) dt \cong \Delta t \sum_{n=1}^{n_2} Qnj$$


$$kWhi = \int_{t_1}^{t_2} Pi(t) dt \cong \Delta t \sum_{i=1}^{n_2} Pnj$$

Where:


i= considered phase (L1, L2 or L3) P= active power; Q= reactive power;  $t_1$ ,  $t_2$  =starting and ending time points of consumption recording; **n**= time unit  $\Delta$ ;  $\Delta t$ = time interval between two successive power consumptions;  $n_1$ ,  $n_2$  = starting and ending discrete time points of consumption recording




### Wiring diagrams





#### System type selection: 3-Ph.2






#### System type selection: 3-Ph.n








#### System type selection: 3-Ph



#### System type selection: 3-Ph (cont.)












## Wiring diagrams


#### System type selection: 3-Ph.1









#### System type selection: 2-Ph (cont.)





#### System type selection: 1-Ph






#### **Power Supply**











## Static, relay and analogue outputs wiring diagrams

















## RS485 and RS232 wiring diagrams









**NOTE.** RS485: additional devices provided with RS485 are connected in parallel. The termination of the serial output is carried out only on the last instrument of the network, by means of a jumper between (B+) and (T). : the communication RS232 and RS485 ports **can't be** connected and used simultaneously.




### RS485 wiring diagram of Bacnet module



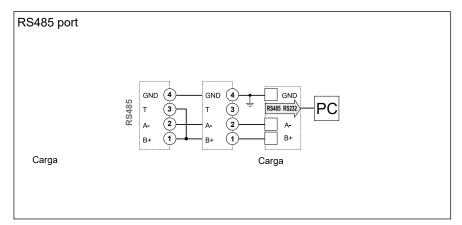


**NOTE.** RS485: additional devices provided with RS485 are connected in parallel. The termination of the serial output is carried out only on the last instrument of the network, by means of a jumper between (B+) and (T).

### **Ethernet and BACnet-IP connections**



Connection to Ethernet or BACnet modules using the RJ45 connector.


### **Profibus module connections**

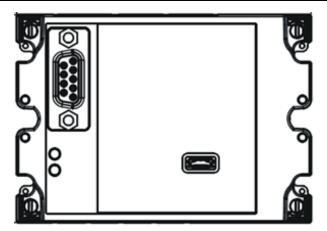

Connection to the Profibus module using USB micro type B (Modbus RTU) and RS485 DB9 (Profibus DP-V0).



## Front panel description

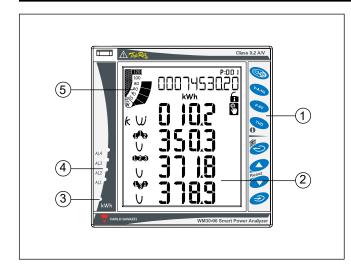

#### 1. Key-pad

To program the configuration parameters and scroll the variables on the display.

#### 2. Display

LCD-type with alphanumeric indications to:

- display configuration parameters;
- display all the measured variables.

#### 3. kWh LED

Red LED blinking proportional to the energy being measured

#### 4. Alarm LED's

Red LED's light-on when virtual alarms are activated.

#### 5. Main bar-graph

To display the power consumption versus the installed power.

### **Dimensions and Panel cut-out**

